

CU-LT

Optimized rectangular fire damper up to 120'



Table of content

Declaration of performance	3
Product presentation CU-LT	4
Range and dimensions CU-LT	4
Evolution - kits	5
Options - at the time of order	7
Flange types - at the time of order	7
Storage and handling	8
Installation	8
Operation and mechanisms	18
Electrical connection	20
Weights	22
Selection graphs	23
Selection data	24
Correction factor ΔL	28
Sample order	28
Approvals and certificates	28

Explanation of the abbreviations and pictograms

Wn = nominal width	V DC = Volt direct current	KIT = kit (delivered separately for repair or upgrade)
Hn = nominal height	E.ALIM = power supply magnet	PG = connection flange to the duct
Dn = nominal diameter	E.TELE = power supply motor	Sn = free air passage
E = integrity	V = volt	$\zeta [-]$ = pressure loss coefficient
I = thermal insulation	W = watt	Q = air flow
S = smoke leakage	Auto = automatic	ΔP = static pressure drop
Pa = pascal	Tele = remote controlled	v = air speed in the duct
ve = vertical wall penetration	Pnom = nominal capacity	Lwa = A-weighted sound power level
ho = horizontal floor penetration	Pmax = maximum capacity	Lw oct = sound power level per octave midband
o -> i = meets the criteria from the outside (o) to the inside (i)	GKB (type A) / GKF (type F): "GKB" stands for standard plasterboards (type A according to EN 520) while "GKF" plasterboards offer a higher fire resistance for a similar plate thickness (type F according to EN 520)	dB(A)a = A-weighted decibel value
i <-> o = fire side not important	Cal-Sil = calcium silicate	ΔL = correction factor
V AC = Volt alternating current	OP = option (delivered with the product)	

	air-tightness class C according to EN1751		higher net building volume
	optimal acoustic performance		optimal free air passage and minimal pressure loss
	suitable for built-in installation		suitable for installation remote from the wall
	intermediate dimensions on request		sealing with fire resistant stone wool boards allowed, also for asymmetric opening

DECLARATION OF PERFORMANCE

CE DOP Rf-t C3 EN D-02/2015

1. Unique identification code of the product type:	Rectangular fire damper
2. Identification of the construction product:	CU-LT
3. Intended use(s) of the construction product:	Rectangular fire damper to be used in conjunction with partitions to maintain fire compartments in heating, ventilating and air conditioning installations.
4. Name and contact address of the manufacturer:	Rf-Technologies NV, Lange Ambachtstraat 40, B-9860 Oosterzele
5. System of assessment and verification of constancy of performance of the construction product:	System 1
6. In case of the declaration of performance concerning a construction product covered by a harmonised standard:	Notified factory production control certification body BCCA with identification number 0749 performed the determination of the product type on the basis of type testing (including sampling), the initial inspection of the manufacturing plant and of factory production control and continuous surveillance, assessment and evaluation of factory production control under system 1 and issued the certificate of constancy of performance BC1-606-0464-15650-05-0464-BC1-606-0464-15650-15-2517
7. Declared performance according to EN 15650:2010	(Fire resistance according to EN 1366-2 and classifications according to EN 13501-3)

Essential characteristics				Performance	
Range	Wall type	Wall	Sealing	Installation	Classification
200x100 mm ≤ CU-LT ≤ 800x600 mm	Rigid wall	Aerated concrete ≥ 100mm	Mortar	1	EI 90 (V _e , i ↔ o) S - (500 Pa)
			Gypsum	1	EI 120 (V _e , i ↔ o) S - (500 Pa)
			Mineral wool + coating ≥ 150 kg/m³ + endothermic coated casing	1	EI 120 (V _e , i ↔ o) S - (300 Pa)
			Galvanised duct + PROMASTOP®-CB 1x60 mm + IFW installation kit	2	EI 60 (V _e , i ↔ o) S - (300 Pa)
			Galvanised duct + PROMASTOP®-CB 1x80 mm + IFW installation kit	2	EI 90 (V _e , i ↔ o) S - (300 Pa)
			Galvanised duct + PROMASTOP®-CB 2x50 mm + IFW installation kit	2	EI 90 (V _e , i ↔ o) S - (300 Pa)
	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) ≥ 100mm	Galvanised duct + GEOFLAM® F 45mm + mortar	2	EI 120 (V _e , i ↔ o) S - (500 Pa)
			IFW installation kit	1	EI 90 (V _e , i ↔ o) S - (500 Pa)
	Rigid floor	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100mm	Mineral wool + coating ≥ 150 kg/m³ + endothermic coated casing	1	EI 60 (V _e , i ↔ o) S - (300 Pa)
			Galvanised duct + PROMASTOP®-CB 1x60 mm + IFW installation kit	2	EI 60 (V _e , i ↔ o) S - (300 Pa)
		Reinforced concrete ≥ 110mm	Mineral wool + coating ≥ 150 kg/m³ + endothermic coated casing	1	EI 120 (V _e , i ↔ o) S - (300 Pa)
			Galvanised duct + PROMASTOP®-CB 2x50 mm + IFW installation kit	2	EI 90 (V _e , i ↔ o) S - (300 Pa)

1	Type of installation: built-in 0/90/180/270°	2	Type of installation: remote from the wall, 0/180°
---	--	---	--

Nominal activation conditions/sensitivity:	Pass
Response delay (response time): closure time	Pass
Operational reliability: cycling	MFUSP - 50 cycles; MMAG - 300 cycles; B(L)
Duration of response delay:	F(T) - 10000 cycles; BFL(T) - 10000 cycles
Protection against corrosion according to EN 60068-2-52:	Pass
Damper casing leakage according to EN 1751:	Pass
8. The performance of the product identified in points 1 and 2 is in conformity with the declared performance in point 7. This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.	Pass ≥ class C

Signed for and on behalf of the manufacturer by:
Barbara Willems, Technical Manager

 Oosterzele, 02/2015



Product presentation CU-LT

Product presentation CU-LT


Optimized rectangular fire damper with a fire resistance up to 120 minutes. A minimal pressure loss is guaranteed thanks to the thin blade and the transmission located outside the tunnel. The damper is available in small dimensions (starting from 100 mm height). A galvanized steel tunnel contributes to the light weight of the damper.

Fire dampers are installed where air ducts penetrate fire-resistant compartment walls. Their role is to restore the fire resistance grade of the penetrated wall and to prevent smoke propagation. Fire dampers are distinguished by their degree of fire resistance, by their aerodynamic properties as well as by their installation ease. Rf-Technologies' fire dampers are all CE marked. They can be equipped with various types of mechanisms depending on the specific needs linked to the project or to the local regulations.

- ✓ easy to install
- ✓ optimal free air passage and minimal pressure loss
- ✓ optimal acoustic performance
- ✓ higher net building volume
- ✓ air-tightness class C according to EN1751
- suitable for built-in installation
- suitable for installation remote from the wall
- suitable for rigid wall, rigid floor and light wall (metal stud gypsum plasterboard wall)
- sealing with fire resistant stone wool boards allowed, also for asymmetric opening
- tested according to EN 1366-2 up to 500 Pa
- operating mechanism outside the wall
- maintenance-free
- for indoor use
- intermediate dimensions on request
- operating temperature: max. 50°C



1. casing in galvanised steel
2. damper blade
3. operating mechanism
4. sealing cold smoke
5. intumescent strip
6. base plate for thermo-electrical fuse
7. positioning plate
8. connection flange PG20
9. product identification




Range and dimensions CU-LT

Transmission and mechanism exceed if $H_n \leq 150$ mm

Exceeding blade: X = on the mechanism side, Y = on the wall side



Hn (mm)	150	200	250	300	350	400	450	500	550	600
x	-	-	-	-	-	-	-	17	42	67
y	2	27	52	77	102	127	152	177	202	227

	IV	IV
(W x H) mm	200x100	800x600



H < 200 mm

H ≥ 200 mm



	MFUSP	MMAG	BFL(T)		MFUSP	MMAG	BFL(T)
P	103	143	80	P	103	143	80
Q	123	173	80	Q	122	120	80
Z	62	62	40	Z	93	28	40

Evolution - kits


KITS MFUSP

Automatic unlocking mechanism with fusible link


KITS MMAG

Upgradeable automatically unlocking mechanism


KITS BFL24

Spring return actuator BFL 24V


KITS BFL24-ST

Spring return actuator BFL 24V with plug (ST)


KITS BFLT24

Spring return actuator BFL 24V with thermo-electric fuse (T)


KITS BFLT24-ST

Spring return actuator BFL 24V with thermo-electric fuse (T) and plug (ST)


KITS BFL230

Spring return actuator BFL 230V



	KITS BFLT230	Spring return actuator BFL 230V with thermo-electric fuse (T)
	KITS BFN24	Spring return actuator BFN 24V (BFN kits must be used instead of BFL kits for fire dampers produced before 1/7/2015)
	KITS VD MMAG FDCU	Natural magnet 24/48 V DC + FDCU
	KITS VM MMAG FDCU	Electromagnet 24/48 V DC + FDCU
	KITS FDCU MFUS(P)	Unipolar beginning and end of range switch
	KITS FDCU MMAG	Unipolar beginning and end of range switch
	KITS FDCB MMAG	Bipolar beginning and end of range switch
	KITS SN2 BFL/BFN	Bipolar beginning and end of range switch
	KITS ME MMAG	Resetting motor ME 24V/48V (DC)
	KITS ZBAT 72	Black spare part for thermo-electric fuse for BFLT/BFNT

	KITS FUS 72 MFUS(P)	Fusible link 72°C
	KITS FUS72 MMAG	Fusible link 72°C
	MECT	Testbox for mechanisms (magnet, motor, beginning and end of range switches)
	CU-LT IFW	Separate installation kit for flexible wall for CU-LT (800 x 600 mm, must be cut to size)

Options - at the time of order

	IFW	Pre-mounted installation kit for flexible wall
	UL	Inspection shutter (set of 2)

Flange types - at the time of order

	PG20	Connection to ducts with 20mm flanges (either with sliding profile or with bolts). Elliptical holes $\varnothing 9,5 \times 16$ mm.
	PR	Circular connection on a rectangular damper with PG20 flange.
	PRJ	Circular connection with rubber sealing ring on a rectangular damper with PG20 flange.

Storage and handling

As this product is a safety element, it should be stored and handled with care.

Avoid:

- any kind of impact or damage
- contact with water
- deformation of the casing

It is recommended:



- to unload in a dry area
- not to flip or roll the product to move it
- not to use the damper as a scaffold, working table, etc.
- not to store smaller dampers inside larger ones

Installation


General points

- The installation must comply with the classification report and the installation manual delivered with the product.
- Axis orientation: see the declaration of performance.
- Avoid obstruction of adjoining ducts.
- Product installation: always with closed damper blade.
- Verify if the blade can move freely.
- Please observe safety distances with respect to other construction elements.
- The air tightness class will be maintained if the damper is installed according to the installation manual.
- Rf-t fire dampers are always tested in standardized constructions according to EN 1366-2. The achieved results are valid for similar supporting constructions with a fire resistance, thickness and density equal or superior to the supporting construction used during the test.
- The damper must remain accessible for inspection and maintenance.
- Schedule at least two running checks each year.

	TEST	
2015	☒	☒
2016	☒	☒
2017	☒	☐
2018	☐	☐
2019	☐	☐

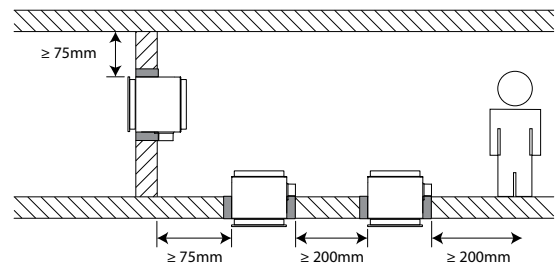

Position of the thermo-electric fuse (spring-return actuator BFLT)


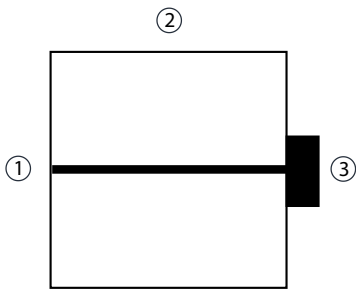


Position of the thermo-electric fuse on the damper casing: 1. on opposite side of mechanism if $H < 250$ mm and $W < 250$ mm; 2. on top if $H < 250$ mm and $W \geq 250$ mm; 3. on mechanism side if $H \geq 250$ mm.

Installation in rigid wall and floor

The product was tested and approved in:





Range	Wall type		Sealing	Classification
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid wall	Aerated concrete $\geq 100 \text{ mm}$	Mortar	El 90 (v_e i $\leftrightarrow$ o) S - (500 Pa)
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid wall	Aerated concrete $\geq 100 \text{ mm}$	Gypsum	El 120 (v_e i $\leftrightarrow$ o) S - (500 Pa)
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid floor	Reinforced concrete $\geq 110 \text{ mm}$	Mortar	El 90 (h_o i $\leftrightarrow$ o) S - (500 Pa)
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid floor	Reinforced concrete $\geq 150 \text{ mm}$	Gypsum	El 120 (h_o i $\leftrightarrow$ o) S - (500 Pa)

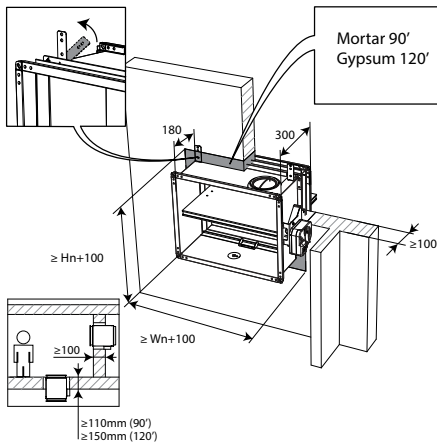

Installation in flexible wall - metal stud gypsum plasterboard wall

The product was tested and approved in:


Range	Wall type	Sealing	Classification
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) $\geq 100 \text{ mm}$	IFW installation kit
			El 90 ($v_e i \leftrightarrow o$) S - (500 Pa)

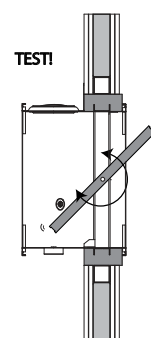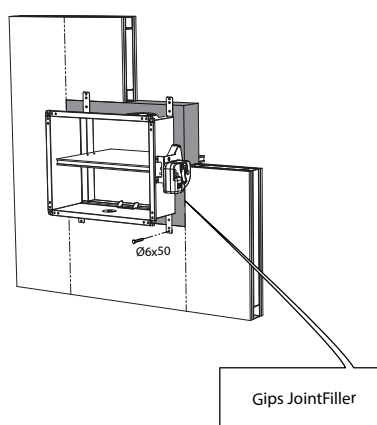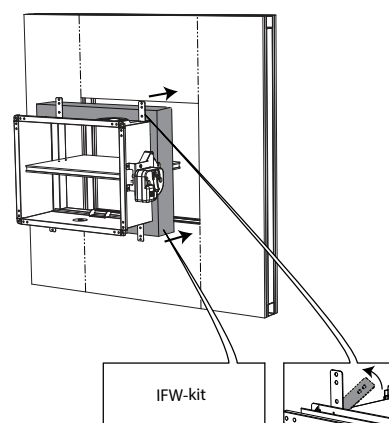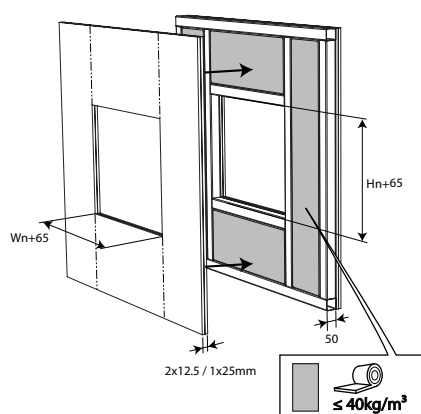



Installation in flexible and rigid wall, sealing with rigid rock wool boards with coating

The product was tested and approved in:



Range	Wall type	Sealing	Classification
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid wall	Aerated concrete $\geq 100 \text{ mm}$	Stone wool + coating $\geq 150 \text{ kg/m}^3$ + endothermic coated casing
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) $\geq 100 \text{ mm}$	Stone wool + coating $\geq 150 \text{ kg/m}^3$
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) $\geq 100 \text{ mm}$	Stone wool + coating $\geq 150 \text{ kg/m}^3$ + endothermic coated casing
			El 120 ($v_e i \leftrightarrow o$) S - (300 Pa)

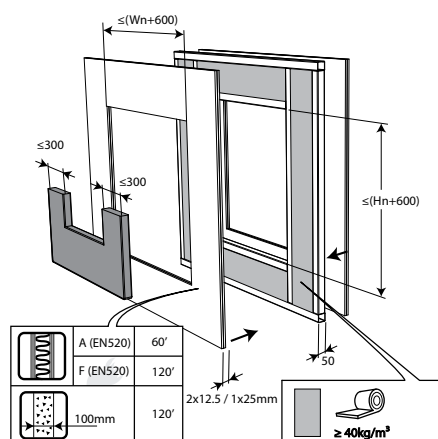


The opening around the damper is sealed with 2 layers of 50 mm-thick mineral wool panels with fire resistant coating on one side (type PROMASTOP-CB 50 or HILTI CFS-CT B).

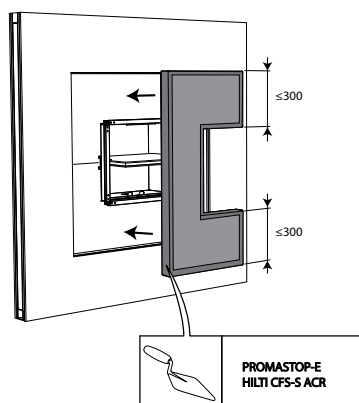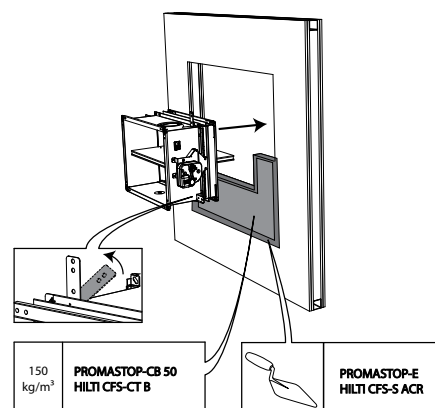


The joints on these 2 layers must be installed staggered and covered all around the edge with endothermic coating (type PROMASTOP-E or HILTI CFS-S-ACR).

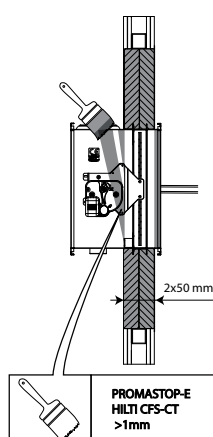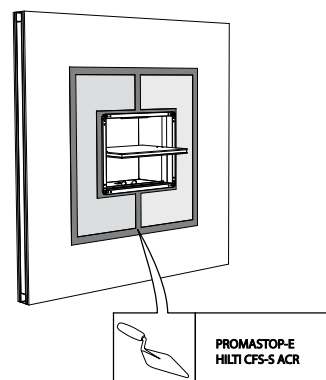

The casing of the fire damper is coated with a layer (>1 mm) of endothermic coating (type PROMASTOP-E or HILTI CFS-CT).




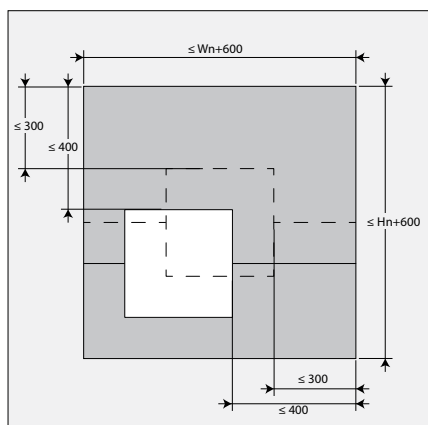


The damper does not need to be centered in the opening (with max dimensions fire damper + 600 mm). The maximal distance between the damper and the edge of the opening is 400 mm.


Installation in rigid floor, sealing with rigid rock wool boards with coating

The product was tested and approved in:



Range	Wall type	Sealing	Classification
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid floor	Aerated concrete $\geq 150 \text{ mm}$ Stone wool + coating $\geq 150 \text{ kg/m}^3$ + endothermic coated casing	El 120 ($h_o i \leftrightarrow o$) S - (300 Pa)

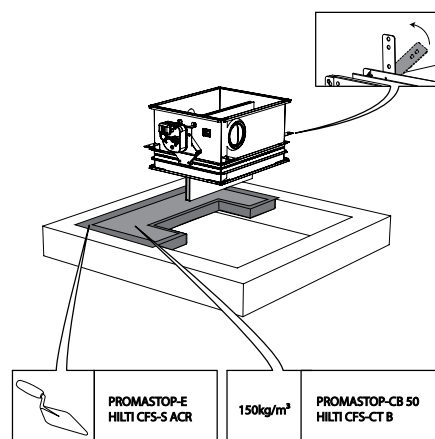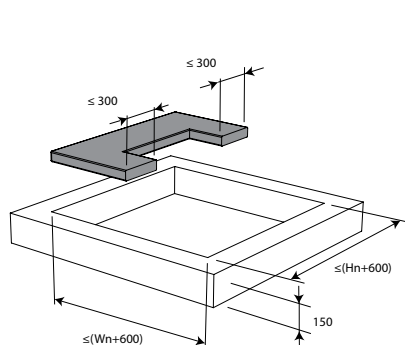



The opening around the damper is sealed with 2 layers of 50 mm-thick mineral wool panels with fire resistant coating on one side (type PROMASTOP-CB 50 or HILTI CFS-CT B).

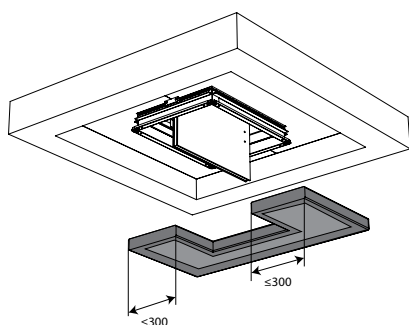

The joints on these 2 layers must be installed staggered and covered all around the edge with endothermic coating (type PROMASTOP-E or HILTI CFS-S-ACR).

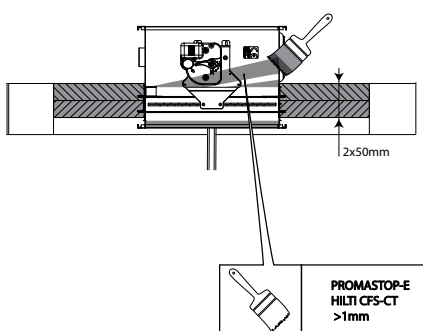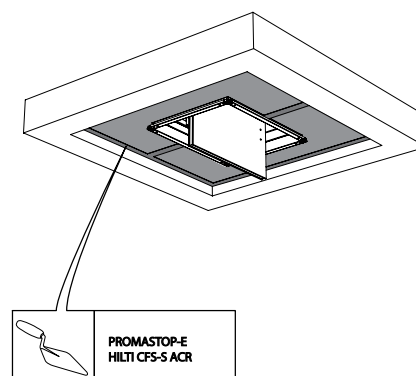

The casing of the fire damper is coated with a layer (>1 mm) of endothermic coating (type PROMASTOP-E or HILTI CFS-CT).

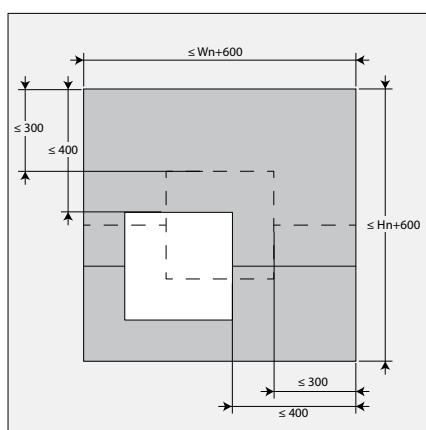
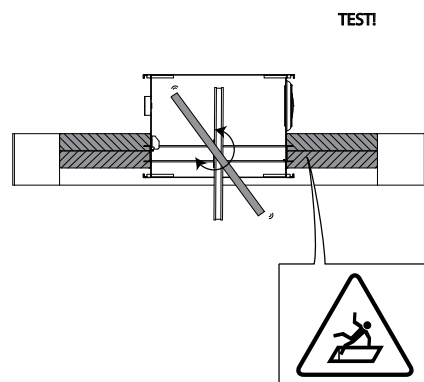


The damper does not need to be centered in the opening (with max dimensions fire damper + 600 mm). The maximal distance between the damper and the edge of the opening is 400 mm.

Installation remote from the wall, sealing and insulation with rigid rock wool boards with coating


The product was tested and approved in:

Range	Wall type	Sealing	Classification
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid wall	Aerated concrete $\geq 100 \text{ mm}$	Galvanised duct + PROMASTOP®-CB 1x60 mm + IFW installation kit
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid wall	Aerated concrete $\geq 100 \text{ mm}$	Galvanised duct + PROMASTOP®-CB 1x80 mm + IFW installation kit
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) $\geq 100 \text{ mm}$	Galvanised duct + PROMASTOP®-CB 1x60 mm + IFW installation kit
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) $\geq 100 \text{ mm}$	Galvanised duct + PROMASTOP®-CB 2x50 mm + IFW installation kit

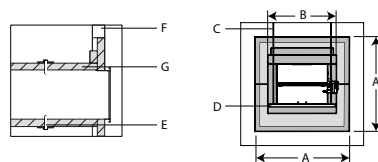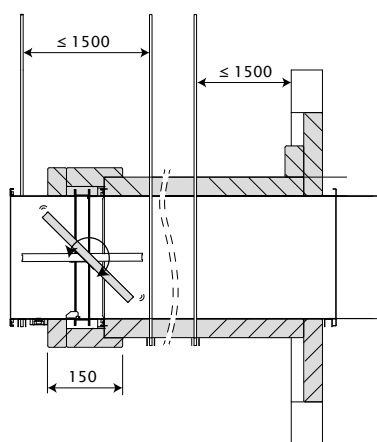


	EI60S	EI90S	EI90S
A	$\leq (H_n+600) \times (B_n+600)$	$\leq (H_n+600) \times (B_n+600)$	$\leq (H_n+600) \times (B_n+600)$
B	$(H_n+120) \times (B_n+120)$	$(H_n+200) \times (B_n+200)$	$(H_n+160) \times (B_n+160)$
C	M8	M8	M8
D	35x35x2mm	50x38x5mm	50x38x5mm
E	$9 \times (\emptyset 5 \times 90 + M6 \times 44) / m^2$	$9 \times (\emptyset 5 \times 120 + M6 \times 44) / m^2$	$9 \times (\emptyset 5 \times 100 + M6 \times 44) / m^2$
F	 100mm (EN520)	 100mm (EN520)	 100mm (EN520)
G	Promastop CB60 1x60mm	Promastop CB50 2x50mm	Promastop CB80 1x80mm

1.

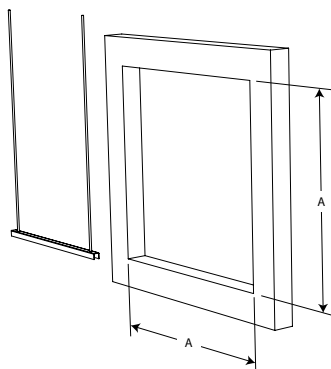


1. An opening with maximal dimensions "A" is made in the wall. For a light partition wall, follow the wall assembly under "Installation in flexible or rigid wall - Sealing with fire resistant rigid panels of stone wool".


2.

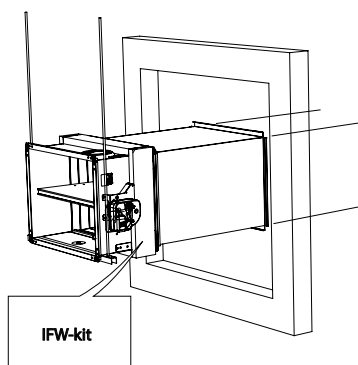

2. The fire damper is equipped with the IFW kit and mounted remote from the wall at the end of a metal duct. The duct is supported every 1500 mm as well as underneath the damper. The suspensions consist of threaded rods "C" and U-shaped steel profiles "D". A free space of maximum 25 mm is left between the threaded rods and the vertical walls of the stone wool casing "B".

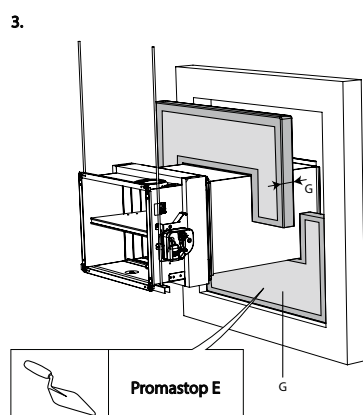


3. The opening around the duct is sealed with stone wool plates type Promastop CB ("G"). The edges are sealed and maintained in place with PROMASTOP E coating.

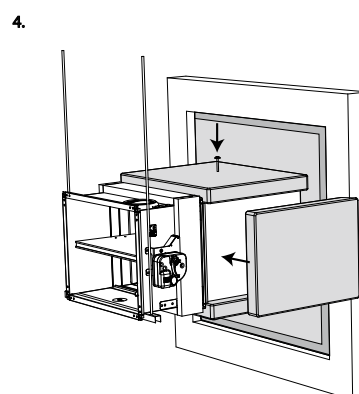


4. The duct is covered over its entire length with stone wool plates "G". To adhere to the duct, the plates are completely coated on one side with PROMASTOP E and affixed to the duct with steel screws and washers "E".

The plates are completely coated on one side with PROMASTOP E and affixed to the duct with steel screws and washers "E". The damper casing is covered with stone wool plates "G" for 150 mm. A free space is left around the mechanism to allow access. The joints between the plates, between the wall and the plates as well as the screws and washers are filled with coating PROMASTOP E.

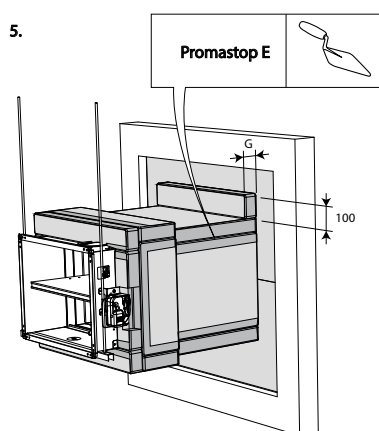

5. An additional mineral wool panel with width "B" and height 100 mm, coated with PROMASTOP E, is applied where the stone wool casing meets the sealing of the wall opening.



6.




Installation remote from the wall + GEOFLAM

The product was tested and approved in:


Range	Wall type	Sealing	Classification
$200 \times 100 \text{ mm} \leq \text{CU-LT} \leq 800 \times 600 \text{ mm}$	Rigid wall	Aerated concrete $\geq 100 \text{ mm}$	Galvanised duct + GEOFLAM® F 45mm + mortar
			El 120 (v_e i $\leftrightarrow$ o) S - (500 Pa)

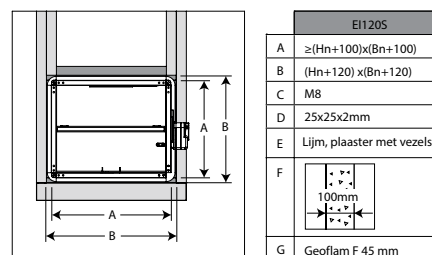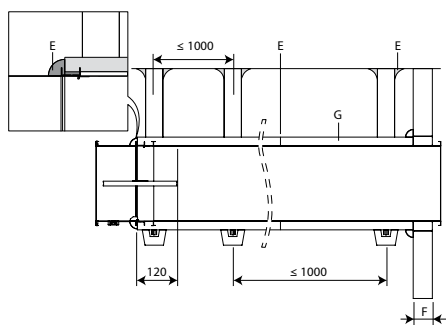

1.

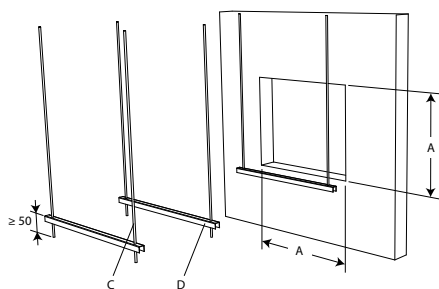


2.

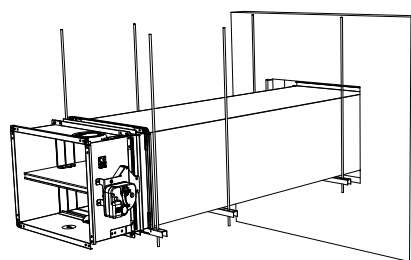


1. An opening with maximal dimensions "A" is made in the wall.


2. The fire damper is mounted remote from the wall at the end of a metal duct. The duct is supported every 1000 mm. The suspensions consist of threaded rods "C" and U-shaped steel profiles "D". A free space of maximum 25 mm is left between the threaded rods and the vertical walls of the casing "B".

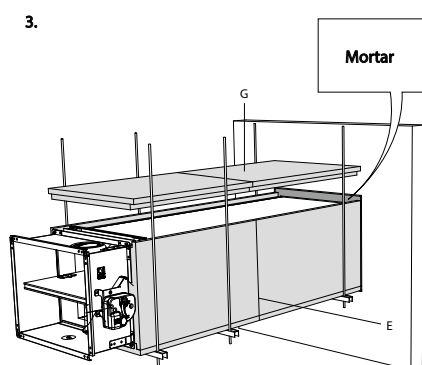


3. The opening around the duct is sealed with standard mortar. The duct is covered with 45 mm thick GEOFLAM F plates "G". The plates adhere to each other with glue and fibrous plaster "E". The damper casing is also covered on a length of 120 mm.

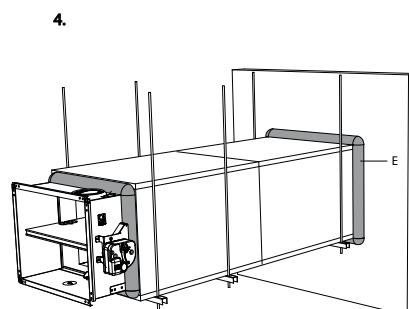

4. The GEOFLAM F plates stop at a distance of 15 mm from the wall. The free space is filled with fibrous plaster. The same filling is applied to seal off the connection between the GEOFLAM F plates and the damper casing.

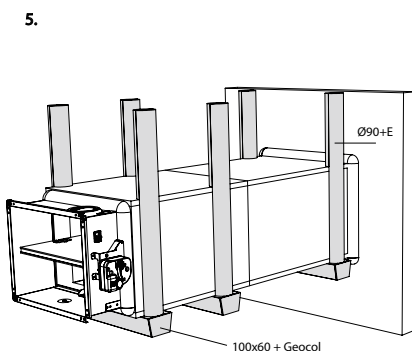

5. The threaded rods are covered with U-shaped plates of GEOFLAM (Ø 90 mm) and affixed with glue and fibrous plaster. The profiles are covered with U-shaped shells GEOFLAM 100 x 60 mm, which are affixed to the underside of the shaft with GEOL (GEOSTAFF) cement plaster.



Maintenance

- No specific maintenance required.
- Schedule at least two running checks each year.
- Remove dust and all other particles before start-up.
- Follow the local maintenance regulations (i.e. BS9999 Annex V; NF S 61-933) and EN13306.


Operation and mechanisms



MFUS(P) Automatic unlocking mechanism

The operating mechanism MFUS(P) automatically unlocks the blade when the temperature in the duct exceeds 72°C. The damper can also be unlocked and reset manually.

1. unlocking button
2. resetting handle
3. cable entrance



Options - at the time of order

FDCU Unipolar beginning and end of range switch

Unlocking

- **manual unlocking:** press the unlocking button (1).
- **automatic unlocking:** the fusible link melts when the temperature reaches 72°C in the duct.
- **remote unlocking:** n/a

Resetting

- **manual resetting:** turn the resetting handle (2) 90° clockwise (or use a 10 mm hex key).
- **motorised resetting:** n/a

Caution:


- ⚠ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.



MMAG Upgradeable automatically unlocking mechanism

The fusible link of the upgradeable unlocking mechanism MMAG automatically unlatches the damper blade when the temperature in the duct rises above 72°C. The damper must be reset manually. The automatic MMAG mechanism is easy to upgrade to a: - Remote controlled mechanism (remote electrical unlocking). - Motorised mechanism (remote resetting).

1. unlocking button
2. resetting handle
3. cable entrance



Options - at the time of order

VD	Natural magnet 24/48 V DC (order with FDCU)
VM	Electromagnet 24/48 V DC (order with FDCU)
FDCU	Unipolar beginning and end of range switch
FDCB	Bipolar beginning and end of range switch (incl. FDCU)
ME	Resetting motor ME 24V/48V (DC)

Unlocking

- **manual unlocking:** press the unlocking button (1).
- **automatic unlocking:** the fusible link melts when the temperature reaches 72°C in the duct.
- **remote unlocking:** option: by sending an electrical impulse (VD) or by interrupting the power supply (VM) to the magnet.

Resetting

- **manual resetting:** turn the resetting handle (2) 90° clockwise (or use a 10 mm hex key).
- **motorised resetting:** (option ME MMAG) switch off the power supply for at least 10 sec. Supply the actuator for at least 30 sec.

(respect the prescribed voltage and polarity). The resetting stops automatically if a torque >15 Nm is detected.

Caution:

- ⚠ Switch off the power supply after resetting.
- ⚠ Switch off the power supply for at least 15 sec. in between each resetting cycle.

Caution:


- ⚠ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.



BFL(T) Remotely controlled spring return actuator

The spring return actuator BFL(T) is specially designed to remotely control fire dampers. The BFL(T) model is intended for fire dampers with smaller dimensions ($\varnothing \leq 400$ mm or $W+H \leq 1200$ mm/1400 mm for CU-LT, CU-LT-1s).

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)



Options - at the time of order

SN2 BFL/BFN	Bipolar beginning and end of range switch
IXI-R1	Universal field controller (Modbus, BACnet or analog connection), pre-mounted on the damper.
IXI-R2	Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper.

Unlocking

- **manual unlocking:** place the locking button on “unlock”. (In case of BFLT: the damper can alternatively be unlocked by pushing the “test” button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFLT).
- **remote unlocking:** by interrupting the power supply.

Caution:

- ⚠ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

Resetting

- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on “lock”
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.

Caution:

- ⚠ Do not use a drill or screwing machine.
- ⚠ Stop as soon as the motor is completely rearmed (end of range).


Caution:

- ⚠ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.


	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit BFL								
Kit BFN	●	●	●		●	●	●	●
Kit BF				●				

Electrical connection


MFUS(P)



MMAG



BFL(T)



MEC	Nominal voltage motor	Nominal voltage magnet	Power consumption (stand-by)	Power consumption (operating)	standard switches	
MFUSP	N/A	N/A	N/A	N/A	1mA...1A, DC 5V...AC 48V	
MMAG	24/48 V DC (automatic conversion)	24/48 V DC (automatic conversion in FDCU printed circuit / entrance capacity: 25 µF)	VM: 1,9W / VD: - / ME: -	VM: - / VD: 3,5W / ME: Pmax 10W (24V)/15W (48V)	1mA...500mA, DC 5V...AC 48V	
BFL24	24 V AC / 24 V DC	N/A	0,7W	2,5W	1mA...3A, AC 250V	
BFL24-ST	24 V AC / 24 V DC	N/A	0,7W	2,5W	1mA...3A, AC 250V	
BFLT24	24 V AC / 24 V DC	N/A	0,8W	2,5W	1mA...3A, AC 250V	
BFLT24-ST	24 V AC / 24 V DC	N/A	0,8W	2,5W	1mA...3A, AC 250V	
BFL230	230 V AC	N/A	1,1W	3,5W	1mA...3A, AC 250V	
BFLT230	230 V AC	N/A	1,4W	4W	1mA...3A, AC 250V	

	running time motor	running time spring	noise level motor	noise level spring	cable supply / control	cable auxiliary switch	Protection class
	N/A	1 s	N/A	N/A			IP 42
	< 30 s	1 s	≤ 66 dB (A)	N/A			IP 42
	< 60 s	20 s	≤ 45 dB (A)	ca. 63 dB (A)	1 m, 2 x 0.34 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
	< 60 s	20 s	≤ 45 dB (A)	ca. 63 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
	< 60 s	20 s	≤ 45 dB (A)	ca. 63 dB (A)	1 m, 2 x 0.34 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
	< 60 s	20 s	≤ 45 dB (A)	ca. 63 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
	< 60 s	20 s	≤ 45 dB (A)	ca. 63 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
	< 60 s	20 s	≤ 45 dB (A)	ca. 63 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54

Weights

CCU-LT + MFUSP

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800
100	kg	3,6	4,0	4,4	4,7	5,1	5,5	5,9	6,2	6,6	7,0	7,3	7,7	8,1
150	kg	4,1	4,5	5,0	5,4	5,8	6,2	6,7	7,1	7,5	8,0	8,4	8,8	9,2
200	kg	4,6	5,1	5,6	6,0	6,5	7,0	7,5	8,0	8,5	8,9	9,4	9,9	10,4
250	kg	5,1	5,6	6,1	6,7	7,2	7,8	8,3	8,8	9,4	9,9	10,5	11,0	11,5
300	kg	5,6	6,1	6,7	7,3	7,9	8,5	9,1	9,7	10,3	10,9	11,5	12,1	12,7
350	kg	6,0	6,7	7,3	8,0	8,6	9,3	9,9	10,6	11,2	11,9	12,5	13,2	13,8
400	kg	6,5	7,2	7,9	8,6	9,3	10,1	10,8	11,5	12,2	12,9	13,6	14,3	15,0
450	kg	7,0	7,8	8,5	9,3	10,1	10,8	11,6	12,3	13,1	13,9	14,6	15,4	16,2
500	kg	7,5	8,3	9,1	9,9	10,8	11,6	12,4	13,2	14,0	14,8	15,7	16,5	17,3
550	kg	8,0	8,8	9,7	10,6	11,5	12,3	13,2	14,1	15,0	15,8	16,7	17,6	18,5
600	kg	8,5	9,4	10,3	11,2	12,2	13,1	14,0	15,0	15,9	16,8	17,7	18,7	19,6

CU-LT + MMAG

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800
100	kg	4,1	4,5	4,9	5,2	5,6	6,0	6,4	6,7	7,1	7,5	7,8	8,2	8,6
150	kg	4,6	5,0	5,5	5,9	6,3	6,7	7,2	7,6	8,0	8,5	8,9	9,3	9,7
200	kg	5,1	5,6	6,1	6,5	7,0	7,5	8,0	8,5	9,0	9,4	9,9	10,4	10,9
250	kg	5,6	6,1	6,6	7,2	7,7	8,3	8,8	9,3	9,9	10,4	11,0	11,5	12,0
300	kg	6,1	6,6	7,2	7,8	8,4	9,0	9,6	10,2	10,8	11,4	12,0	12,6	13,2
350	kg	6,5	7,2	7,8	8,5	9,1	9,8	10,4	11,1	11,7	12,4	13,0	13,7	14,3
400	kg	7,0	7,7	8,4	9,1	9,8	10,6	11,3	12,0	12,7	13,4	14,1	14,8	15,5
450	kg	7,5	8,3	9,0	9,8	10,6	11,3	12,1	12,8	13,6	14,4	15,1	15,9	16,7
500	kg	8,0	8,8	9,6	10,4	11,3	12,1	12,9	13,7	14,5	15,3	16,2	17,0	17,8
550	kg	8,5	9,3	10,2	11,1	12,0	12,8	13,7	14,6	15,5	16,3	17,2	18,1	19,0
600	kg	9,0	9,9	10,8	11,7	12,7	13,6	14,5	15,5	16,4	17,3	18,2	19,2	20,1



CU-LT + BFL

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800
100	kg	4,3	4,7	5,1	5,4	5,8	6,2	6,6	6,9	7,3	7,7	8,0	8,4	8,8
150	kg	4,8	5,2	5,7	6,1	6,5	6,9	7,4	7,8	8,2	8,7	9,1	9,5	9,9
200	kg	5,3	5,8	6,3	6,7	7,2	7,7	8,2	8,7	9,2	9,6	10,1	10,6	11,1
250	kg	5,8	6,3	6,8	7,4	7,9	8,5	9,0	9,5	10,1	10,6	11,2	11,7	12,2
300	kg	6,3	6,8	7,4	8,0	8,6	9,2	9,8	10,4	11,0	11,6	12,2	12,8	13,4
350	kg	6,7	7,4	8,0	8,7	9,3	10,0	10,6	11,3	11,9	12,6	13,2	13,9	14,5
400	kg	7,2	7,9	8,6	9,3	10,0	10,8	11,5	12,2	12,9	13,6	14,3	15,0	15,7
450	kg	7,7	8,5	9,2	10,0	10,8	11,5	12,3	13,0	13,8	14,6	15,3	16,1	16,9
500	kg	8,2	9,0	9,8	10,6	11,5	12,3	13,1	13,9	14,7	15,5	16,4	17,2	18,0
550	kg	8,7	9,5	10,4	11,3	12,2	13,0	13,9	14,8	15,7	16,5	17,4	18,3	19,2
600	kg	9,2	10,1	11,0	11,9	12,9	13,8	14,7	15,7	16,6	17,5	18,4	19,4	20,3

CU-LT + BFLT

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800
100	kg	4,4	4,8	5,2	5,5	5,9	6,3	6,7	7,0	7,4	7,8	8,1	8,5	8,9
150	kg	4,9	5,3	5,8	6,2	6,6	7,0	7,5	7,9	8,3	8,8	9,2	9,6	10,0
200	kg	5,4	5,9	6,4	6,8	7,3	7,8	8,3	8,8	9,3	9,7	10,2	10,7	11,2
250	kg	5,9	6,4	6,9	7,5	8,0	8,6	9,1	9,6	10,2	10,7	11,3	11,8	12,3
300	kg	6,4	6,9	7,5	8,1	8,7	9,3	9,9	10,5	11,1	11,7	12,3	12,9	13,5
350	kg	6,8	7,5	8,1	8,8	9,4	10,1	10,7	11,4	12,0	12,7	13,3	14,0	14,6
400	kg	7,3	8,0	8,7	9,4	10,1	10,9	11,6	12,3	13,0	13,7	14,4	15,1	15,8
450	kg	7,8	8,6	9,3	10,1	10,9	11,6	12,4	13,1	13,9	14,7	15,4	16,2	17,0
500	kg	8,3	9,1	9,9	10,7	11,6	12,4	13,2	14,0	14,8	15,6	16,5	17,3	18,1
550	kg	8,8	9,6	10,5	11,4	12,3	13,1	14,0	14,9	15,8	16,6	17,5	18,4	19,3
600	kg	9,3	10,2	11,1	12,0	13,0	13,9	14,8	15,8	16,7	17,6	18,5	19,5	20,4

Selection graphs

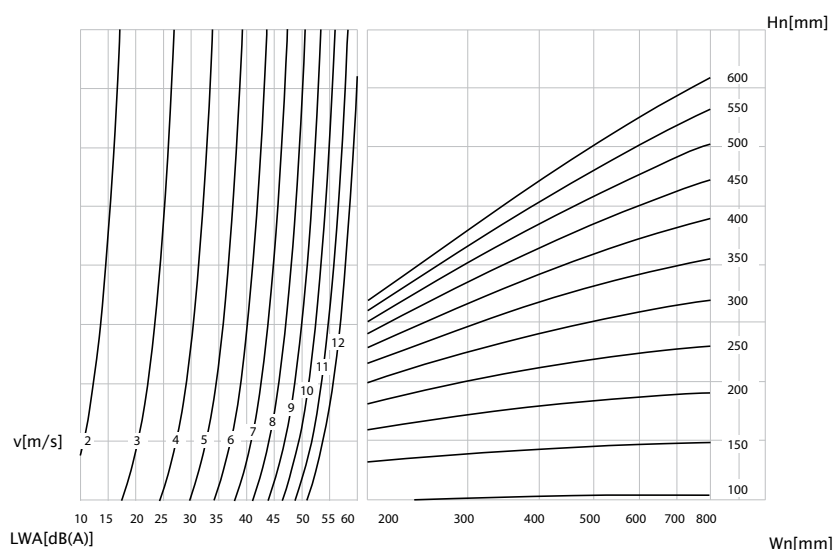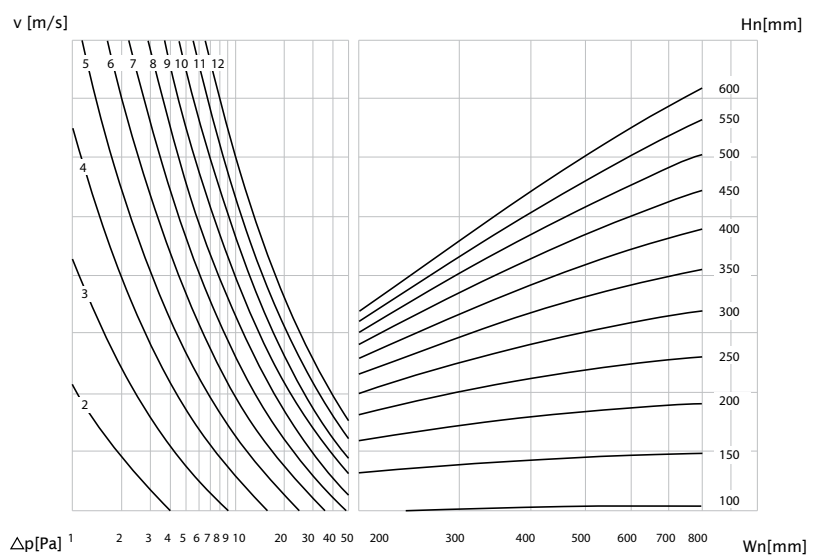

$$\Delta p \text{ [Pa]} = \zeta^* v^2 \cdot 0,6$$

Hn\Wn [mm]	200	250	300	350	400	450	500	550	600	650	700	750	800
100 ζ [-]	1,69	1,65	1,62	1,60	1,59	1,58	1,57	1,56	1,55	1,55	1,54	1,54	1,54
150 ζ [-]	0,98	0,93	0,89	0,87	0,85	0,83	0,82	0,81	0,80	0,80	0,79	0,79	0,78
200 ζ [-]	0,69	0,63	0,60	0,57	0,55	0,54	0,52	0,51	0,51	0,50	0,49	0,49	0,49
250 ζ [-]	0,54	0,48	0,44	0,42	0,40	0,39	0,37	0,37	0,36	0,35	0,35	0,34	0,34
300 ζ [-]	0,45	0,39	0,35	0,33	0,31	0,30	0,29	0,28	0,27	0,26	0,26	0,26	0,25
350 ζ [-]	0,39	0,33	0,30	0,27	0,25	0,24	0,23	0,22	0,22	0,21	0,21	0,20	0,20
400 ζ [-]	0,34	0,29	0,26	0,23	0,22	0,20	0,19	0,18	0,18	0,17	0,17	0,16	0,16
450 ζ [-]	0,31	0,26	0,23	0,20	0,19	0,17	0,16	0,16	0,15	0,15	0,14	0,14	0,13
500 ζ [-]	0,29	0,24	0,20	0,18	0,17	0,15	0,14	0,14	0,13	0,13	0,12	0,12	0,12
550 ζ [-]	0,27	0,22	0,19	0,16	0,15	0,14	0,13	0,12	0,12	0,11	0,11	0,10	0,10
600 ζ [-]	0,25	0,20	0,17	0,15	0,14	0,12	0,12	0,11	0,10	0,10	0,10	0,09	0,09

Selection data

CU-LT - A-weighted sound power level in the duct

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800	
100	Sn [m²]	0,0099	0,0127	0,0154	0,0182	0,0209	0,0237	0,0264	0,0292	0,0319	0,0347	0,0374	0,0402	0,0429	45 dB
	Sn [%]	54,29	55,15	55,72	56,13	56,43	56,67	56,85	57,00	57,13	57,24	57,33	57,41	57,48	
	Q [m³/h]	690,00	860,00	1.030,00	1.200,00	1.360,00	1.530,00	1.700,00	1.870,00	2.030,00	2.200,00	2.370,00	2.540,00	2.700,00	
	Δp [Pa]	93,34	90,41	88,50	87,16	84,91	84,29	83,80	83,41	82,26	82,05	81,86	81,70	80,97	
	Q [m³/h]	560,00	700,00	840,00	970,00	1.110,00	1.250,00	1.380,00	1.520,00	1.650,00	1.790,00	1.930,00	2.060,00	2.200,00	40 dB
	Δp [Pa]	61,48	59,90	58,86	56,95	56,56	56,26	55,22	55,11	54,35	54,32	54,29	53,74	53,75	
	Q [m³/h]	460,00	570,00	680,00	790,00	900,00	1.010,00	1.120,00	1.230,00	1.350,00	1.460,00	1.570,00	1.680,00	1.790,00	35 dB
	Δp [Pa]	41,49	39,71	38,57	37,77	37,19	36,73	36,38	36,08	36,38	36,13	35,92	35,74	35,59	
	Q [m³/h]	370,00	460,00	550,00	640,00	730,00	820,00	910,00	1.000,00	1.090,00	1.180,00	1.270,00	1.360,00	1.450,00	30 dB
	Δp [Pa]	26,84	25,87	25,23	24,79	24,46	24,21	24,01	23,85	23,72	23,60	23,51	23,42	23,35	
	Q [m³/h]	310,00	380,00	450,00	520,00	600,00	670,00	740,00	820,00	890,00	960,00	1.040,00	1.110,00	1.180,00	25 dB
	Δp [Pa]	18,84	17,65	16,89	16,37	16,53	16,16	15,88	16,04	15,81	15,62	15,76	15,60	15,46	
150	Sn [m²]	0,0189	0,0242	0,0294	0,0347	0,0399	0,0452	0,0504	0,0557	0,0609	0,0662	0,0714	0,0767	0,0819	45 dB
	Sn [%]	67,65	68,73	69,44	69,95	70,33	70,62	70,85	71,04	71,20	71,33	71,45	71,54	71,63	
	Q [m³/h]	940,00	1.170,00	1.390,00	1.610,00	1.840,00	2.060,00	2.290,00	2.510,00	2.730,00	2.960,00	3.180,00	3.410,00	3.630,00	
	Δp [Pa]	24,09	22,59	21,62	20,94	20,14	19,80	19,52	19,30	18,93	18,79	18,67	18,57	18,34	
	Q [m³/h]	770,00	950,00	1.130,00	1.310,00	1.490,00	1.680,00	1.860,00	2.040,00	2.220,00	2.400,00	2.590,00	2.770,00	2.950,00	40 dB
	Δp [Pa]	30,00	27,56	26,02	24,96	24,18	23,87	23,37	22,97	22,64	22,36	22,30	22,08	21,90	
	Q [m³/h]	620,00	770,00	920,00	1.070,00	1.220,00	1.360,00	1.510,00	1.660,00	1.810,00	1.960,00	2.100,00	2.250,00	2.400,00	35 dB
	Δp [Pa]	19,45	18,11	17,25	16,65	16,21	15,64	15,40	15,21	15,05	14,91	14,66	14,57	14,49	
	Q [m³/h]	510,00	630,00	750,00	870,00	990,00	1.110,00	1.230,00	1.350,00	1.470,00	1.590,00	1.710,00	1.830,00	1.950,00	30 dB
	Δp [Pa]	13,16	12,12	11,46	11,01	10,67	10,42	10,22	10,06	9,93	9,81	9,72	9,64	9,57	
	Q [m³/h]	410,00	510,00	610,00	710,00	810,00	900,00	1.000,00	1.100,00	1.200,00	1.290,00	1.390,00	1.490,00	1.590,00	25 dB
	Δp [Pa]	8,51	7,94	7,58	7,33	7,15	6,85	6,76	6,68	6,61	6,46	6,42	6,39	6,36	

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800	
200	Sn [m ²]	0,0279	0,0357	0,0434	0,0512	0,0589	0,0667	0,0744	0,0822	0,0899	0,0977	0,1054	0,1132	0,1209	
	Sn [%]	74,13	75,31	76,09	76,65	77,06	77,38	77,63	77,84	78,01	78,16	78,29	78,39	78,49	
	Q [m ³ /h]	1.190,00	1.470,00	1.750,00	2.030,00	2.310,00	2.590,00	2.860,00	3.140,00	3.420,00	3.700,00	3.980,00	4.260,00	4.530,00	45 dB
	Δp [Pa]	28,38	25,37	23,49	22,20	21,26	20,55	19,85	19,42	19,06	18,77	18,51	18,29	18,02	
	Q [m ³ /h]	970,00	1.200,00	1.420,00	1.650,00	1.880,00	2.100,00	2.330,00	2.550,00	2.780,00	3.010,00	3.230,00	3.460,00	3.690,00	40 dB
	Δp [Pa]	18,85	16,91	15,46	14,67	14,08	13,51	13,18	12,81	12,60	12,42	12,19	12,07	11,96	
	Q [m ³ /h]	790,00	970,00	1.160,00	1.340,00	1.530,00	1.710,00	1.890,00	2.080,00	2.260,00	2.450,00	2.630,00	2.810,00	3.000,00	35 dB
	Δp [Pa]	12,51	11,05	10,32	9,67	9,33	8,96	8,67	8,52	8,32	8,23	8,08	7,96	7,90	
	Q [m ³ /h]	640,00	790,00	940,00	1.090,00	1.240,00	1.390,00	1.540,00	1.690,00	1.840,00	1.990,00	2.140,00	2.290,00	2.440,00	30 dB
	Δp [Pa]	8,21	7,33	6,78	6,40	6,13	5,92	5,76	5,63	5,52	5,43	5,35	5,29	5,23	
	Q [m ³ /h]	520,00	640,00	770,00	890,00	1.010,00	1.130,00	1.250,00	1.370,00	1.500,00	1.620,00	1.740,00	1.860,00	1.980,00	25 dB
	Δp [Pa]	5,42	4,81	4,55	4,27	4,06	3,91	3,79	3,70	3,67	3,60	3,54	3,49	3,44	
250	Sn [m ²]	0,0369	0,0472	0,0574	0,0677	0,0779	0,0882	0,0984	0,1087	0,1189	0,1292	0,1394	0,1497	0,1599	
	Sn [%]	77,95	79,20	80,02	80,60	81,03	81,37	81,64	81,85	82,04	82,19	82,32	82,44	82,53	
	Q [m ³ /h]	1.440,00	1.770,00	2.100,00	2.440,00	2.770,00	3.100,00	3.430,00	3.760,00	4.090,00	4.420,00	4.750,00	5.090,00	5.420,00	45 dB
	Δp [Pa]	20,74	17,89	16,14	15,08	14,21	13,56	13,05	12,64	12,31	12,03	11,80	11,64	11,46	
	Q [m ³ /h]	1.170,00	1.440,00	1.710,00	1.980,00	2.250,00	2.520,00	2.790,00	3.060,00	3.330,00	3.600,00	3.870,00	4.130,00	4.400,00	40 dB
	Δp [Pa]	13,69	11,84	10,70	9,93	9,38	8,96	8,63	8,37	8,16	7,98	7,83	7,66	7,55	
	Q [m ³ /h]	950,00	1.170,00	1.390,00	1.610,00	1.830,00	2.050,00	2.270,00	2.490,00	2.710,00	2.920,00	3.140,00	3.360,00	3.580,00	35 dB
	Δp [Pa]	9,03	7,82	7,07	6,57	6,20	5,93	5,71	5,54	5,40	5,25	5,15	5,07	5,00	
	Q [m ³ /h]	780,00	950,00	1.130,00	1.310,00	1.490,00	1.670,00	1.840,00	2.020,00	2.200,00	2.380,00	2.560,00	2.730,00	2.910,00	30 dB
	Δp [Pa]	6,08	5,15	4,67	4,35	4,11	3,93	3,75	3,65	3,56	3,49	3,43	3,35	3,30	
	Q [m ³ /h]	630,00	780,00	920,00	1.070,00	1.210,00	1.360,00	1.500,00	1.640,00	1.790,00	1.930,00	2.080,00	2.220,00	2.370,00	25 dB
	Δp [Pa]	3,97	3,47	3,10	2,90	2,71	2,61	2,50	2,40	2,36	2,29	2,26	2,21	2,19	
300	Sn [m ²]	0,0459	0,0587	0,0714	0,0842	0,0969	0,1097	0,1224	0,1352	0,1479	0,1607	0,1734	0,1862	0,1989	
	Sn [%]	80,48	81,76	82,60	83,20	83,65	84,00	84,28	84,50	84,69	84,85	84,99	85,10	85,21	
	Q [m ³ /h]	1.690,00	2.070,00	2.450,00	2.840,00	3.220,00	3.600,00	3.990,00	4.370,00	4.750,00	5.130,00	5.520,00	5.900,00	6.280,00	45 dB
	Δp [Pa]	16,45	13,78	12,16	11,16	10,38	9,80	9,40	9,03	8,73	8,49	8,31	8,13	7,98	
	Q [m ³ /h]	1.370,00	1.680,00	2.000,00	2.310,00	2.620,00	2.930,00	3.240,00	3.550,00	3.860,00	4.170,00	4.480,00	4.790,00	5.110,00	40 dB
	Δp [Pa]	10,81	9,08	8,11	7,39	6,87	6,49	6,20	5,96	5,77	5,61	5,47	5,36	5,28	
	Q [m ³ /h]	1.120,00	1.370,00	1.620,00	1.880,00	2.130,00	2.380,00	2.640,00	2.890,00	3.140,00	3.390,00	3.650,00	3.900,00	4.150,00	35 dB
	Δp [Pa]	7,23	6,04	5,32	4,89	4,54	4,28	4,11	3,95	3,82	3,71	3,63	3,55	3,48	
	Q [m ³ /h]	910,00	1.110,00	1.320,00	1.530,00	1.730,00	1.940,00	2.140,00	2.350,00	2.550,00	2.760,00	2.960,00	3.170,00	3.370,00	30 dB
	Δp [Pa]	4,77	3,96	3,53	3,24	3,00	2,85	2,70	2,61	2,52	2,46	2,39	2,35	2,30	
	Q [m ³ /h]	740,00	910,00	1.070,00	1.240,00	1.410,00	1.580,00	1.740,00	1.910,00	2.080,00	2.240,00	2.410,00	2.580,00	2.740,00	25 dB
	Δp [Pa]	3,15	2,66	2,32	2,13	1,99	1,89	1,79	1,73	1,67	1,62	1,58	1,55	1,52	

Hn\Wn (mm)		200	250	300	350	400	450	500	550	600	650	700	750	800	
350	Sn [m ²]	0,0549	0,0702	0,0854	0,1007	0,1159	0,1312	0,1464	0,1617	0,1769	0,1922	0,2074	0,2227	0,2379	
	Sn [%]	82,26	83,58	84,44	85,05	85,51	85,87	86,15	86,38	86,57	86,74	86,87	86,99	87,10	
	Q [m ³ /h]	1.930,00	2.370,00	2.800,00	3.240,00	3.670,00	4.100,00	4.540,00	4.970,00	5.400,00	5.830,00	6.260,00	6.700,00	7.130,00	45 dB
	Δp [Pa]	13,62	11,24	9,74	8,80	8,09	7,57	7,19	6,87	6,60	6,38	6,20	6,06	5,93	
	Q [m ³ /h]	1.570,00	1.930,00	2.280,00	2.630,00	2.980,00	3.340,00	3.690,00	4.040,00	4.390,00	4.740,00	5.090,00	5.440,00	5.790,00	40 dB
	Δp [Pa]	9,01	7,46	6,46	5,80	5,34	5,02	4,75	4,54	4,36	4,22	4,10	4,00	3,91	
	Q [m ³ /h]	1.280,00	1.570,00	1.850,00	2.140,00	2.430,00	2.710,00	3.000,00	3.280,00	3.570,00	3.850,00	4.140,00	4.430,00	4.710,00	35 dB
	Δp [Pa]	5,99	4,93	4,25	3,84	3,55	3,31	3,14	2,99	2,89	2,78	2,71	2,65	2,59	
	Q [m ³ /h]	1.040,00	1.270,00	1.510,00	1.740,00	1.970,00	2.210,00	2.440,00	2.670,00	2.900,00	3.130,00	3.370,00	3.600,00	3.830,00	30 dB
	Δp [Pa]	3,96	3,23	2,83	2,54	2,33	2,20	2,08	1,98	1,90	1,84	1,80	1,75	1,71	
	Q [m ³ /h]	850,00	1.040,00	1.230,00	1.420,00	1.600,00	1.790,00	1.980,00	2.170,00	2.360,00	2.550,00	2.740,00	2.930,00	3.110,00	25 dB
	Δp [Pa]	2,64	2,17	1,88	1,69	1,54	1,44	1,37	1,31	1,26	1,22	1,19	1,16	1,13	
400	Sn [m ²]	0,0639	0,0817	0,0994	0,1172	0,1349	0,1527	0,1704	0,1882	0,2059	0,2237	0,2414	0,2592	0,2769	
	Sn [%]	83,60	84,93	85,81	86,43	86,90	87,26	87,55	87,78	87,98	88,14	88,28	88,41	88,51	
	Q [m ³ /h]	2.170,00	2.660,00	3.150,00	3.630,00	4.110,00	4.600,00	5.080,00	5.560,00	6.040,00	6.520,00	7.000,00	7.480,00	7.960,00	45 dB
	Δp [Pa]	11,72	9,48	8,14	7,22	6,57	6,12	5,75	5,46	5,22	5,03	4,86	4,72	4,61	
	Q [m ³ /h]	1.770,00	2.160,00	2.560,00	2.950,00	3.350,00	3.740,00	4.130,00	4.520,00	4.910,00	5.300,00	5.690,00	6.080,00	6.470,00	40 dB
	Δp [Pa]	7,80	6,25	5,37	4,77	4,36	4,04	3,80	3,61	3,45	3,32	3,21	3,12	3,04	
	Q [m ³ /h]	1.440,00	1.760,00	2.080,00	2.400,00	2.720,00	3.040,00	3.360,00	3.670,00	3.990,00	4.310,00	4.630,00	4.950,00	5.260,00	35 dB
	Δp [Pa]	5,16	4,15	3,55	3,15	2,88	2,67	2,51	2,38	2,28	2,20	2,13	2,07	2,01	
	Q [m ³ /h]	1.170,00	1.430,00	1.690,00	1.950,00	2.210,00	2.470,00	2.730,00	2.990,00	3.250,00	3.500,00	3.760,00	4.020,00	4.280,00	30 dB
	Δp [Pa]	3,41	2,74	2,34	2,08	1,90	1,76	1,66	1,58	1,51	1,45	1,40	1,36	1,33	
	Q [m ³ /h]	950,00	1.160,00	1.380,00	1.590,00	1.800,00	2.010,00	2.220,00	2.430,00	2.640,00	2.850,00	3.060,00	3.270,00	3.480,00	25 dB
	Δp [Pa]	2,25	1,80	1,56	1,38	1,26	1,17	1,10	1,04	1,00	0,96	0,93	0,90	0,88	
450	Sn [m ²]	0,0729	0,0932	0,1134	0,1337	0,1539	0,1742	0,1944	0,2147	0,2349	0,2552	0,2754	0,2957	0,3159	
	Sn [%]	84,63	85,98	86,87	87,50	87,98	88,34	88,63	88,87	89,07	89,23	89,38	89,50	89,61	
	Q [m ³ /h]	2.420,00	2.960,00	3.490,00	4.020,00	4.560,00	5.090,00	5.620,00	6.150,00	6.680,00	7.200,00	7.730,00	8.260,00	8.790,00	45 dB
	Δp [Pa]	10,45	8,29	6,97	6,11	5,54	5,10	4,76	4,50	4,28	4,09	3,95	3,82	3,72	
	Q [m ³ /h]	1.970,00	2.400,00	2.840,00	3.270,00	3.700,00	4.140,00	4.570,00	5.000,00	5.430,00	5.860,00	6.290,00	6.720,00	7.150,00	40 dB
	Δp [Pa]	6,93	5,45	4,62	4,05	3,65	3,37	3,15	2,97	2,83	2,71	2,61	2,53	2,46	
	Q [m ³ /h]	1.600,00	1.950,00	2.310,00	2.660,00	3.010,00	3.360,00	3.710,00	4.060,00	4.410,00	4.760,00	5.110,00	5.460,00	5.810,00	35 dB
	Δp [Pa]	4,57	3,60	3,05	2,68	2,41	2,22	2,08	1,96	1,87	1,79	1,73	1,67	1,62	
	Q [m ³ /h]	1.300,00	1.590,00	1.880,00	2.160,00	2.450,00	2.730,00	3.020,00	3.300,00	3.590,00	3.870,00	4.150,00	4.440,00	4.720,00	30 dB
	Δp [Pa]	3,02	2,39	2,02	1,77	1,60	1,47	1,38	1,29	1,24	1,18	1,14	1,10	1,07	
	Q [m ³ /h]	1.060,00	1.290,00	1.530,00	1.760,00	1.990,00	2.220,00	2.450,00	2.690,00	2.920,00	3.150,00	3.380,00	3.610,00	3.840,00	25 dB
	Δp [Pa]	2,01	1,57	1,34	1,17	1,06	0,97	0,90	0,86	0,82	0,78	0,75	0,73	0,71	

Hn\Wn [mm]		200	250	300	350	400	450	500	550	600	650	700	750	800	
500	Sn [m²]	0,0819	0,1047	0,1274	0,1502	0,1729	0,1957	0,2184	0,2412	0,2639	0,2867	0,3094	0,3322	0,3549	45 dB
	Sn [%]	85,46	86,82	87,72	88,36	88,83	89,20	89,49	89,73	89,93	90,10	90,25	90,37	90,48	
	Q [m³/h]	2.660,00	3.250,00	3.830,00	4.410,00	4.990,00	5.570,00	6.150,00	6.730,00	7.300,00	7.880,00	8.460,00	9.030,00	9.610,00	
	Δp [Pa]	9,43	7,36	6,12	5,31	4,76	4,35	4,04	3,80	3,59	3,43	3,30	3,18	3,08	
	Q [m³/h]	2.160,00	2.640,00	3.120,00	3.590,00	4.060,00	4.530,00	5.000,00	5.470,00	5.940,00	6.410,00	6.870,00	7.340,00	7.810,00	40 dB
	Δp [Pa]	6,22	4,86	4,06	3,52	3,15	2,88	2,67	2,51	2,38	2,27	2,17	2,10	2,04	
	Q [m³/h]	1.760,00	2.150,00	2.530,00	2.920,00	3.300,00	3.680,00	4.060,00	4.450,00	4.830,00	5.210,00	5.590,00	5.970,00	6.350,00	35 dB
	Δp [Pa]	4,13	3,22	2,67	2,33	2,08	1,90	1,76	1,66	1,57	1,50	1,44	1,39	1,35	
	Q [m³/h]	1.430,00	1.750,00	2.060,00	2.370,00	2.680,00	2.990,00	3.300,00	3.610,00	3.920,00	4.230,00	4.540,00	4.850,00	5.160,00	30 dB
	Δp [Pa]	2,73	2,13	1,77	1,53	1,37	1,25	1,16	1,09	1,04	0,99	0,95	0,92	0,89	
	Q [m³/h]	1.160,00	1.420,00	1.680,00	1.930,00	2.180,00	2.430,00	2.690,00	2.940,00	3.190,00	3.440,00	3.690,00	3.940,00	4.200,00	25 dB
	Δp [Pa]	1,79	1,41	1,18	1,02	0,91	0,83	0,77	0,72	0,69	0,65	0,63	0,61	0,59	
550	Sn [m²]	0,0909	0,1162	0,1414	0,1667	0,1919	0,2172	0,2424	0,2677	0,2929	0,3182	0,3434	0,3687	0,3939	45 dB
	Sn [%]	86,13	87,50	88,41	89,05	89,53	89,90	90,20	90,44	90,64	90,81	90,96	91,08	91,19	
	Q [m³/h]	2.900,00	3.540,00	4.170,00	4.800,00	5.430,00	6.060,00	6.680,00	7.300,00	7.930,00	8.550,00	9.170,00	9.790,00	10.420,00	
	Δp [Pa]	8,64	6,65	5,47	4,71	4,19	3,80	3,50	3,27	3,09	2,94	2,81	2,70	2,61	
	Q [m³/h]	2.360,00	2.880,00	3.390,00	3.900,00	4.410,00	4.920,00	5.430,00	5.940,00	6.440,00	6.950,00	7.460,00	7.960,00	8.470,00	40 dB
	Δp [Pa]	5,73	4,40	3,62	3,11	2,76	2,51	2,32	2,16	2,04	1,94	1,86	1,78	1,73	
	Q [m³/h]	1.920,00	2.340,00	2.760,00	3.170,00	3.590,00	4.000,00	4.420,00	4.830,00	5.240,00	5.650,00	6.060,00	6.470,00	6.880,00	35 dB
	Δp [Pa]	3,79	2,91	2,40	2,05	1,83	1,66	1,53	1,43	1,35	1,28	1,23	1,18	1,14	
	Q [m³/h]	1.560,00	1.900,00	2.240,00	2.580,00	2.920,00	3.250,00	3.590,00	3.920,00	4.260,00	4.590,00	4.930,00	5.260,00	5.600,00	30 dB
	Δp [Pa]	2,50	1,92	1,58	1,36	1,21	1,09	1,01	0,94	0,89	0,85	0,81	0,78	0,75	
	Q [m³/h]	1.270,00	1.550,00	1.820,00	2.100,00	2.370,00	2.650,00	2.920,00	3.190,00	3.460,00	3.730,00	4.010,00	4.280,00	4.550,00	25 dB
	Δp [Pa]	1,66	1,28	1,04	0,90	0,80	0,73	0,67	0,62	0,59	0,56	0,54	0,52	0,50	
600	Sn [m²]	0,0999	0,1277	0,1554	0,1832	0,2109	0,2387	0,2664	0,2942	0,3219	0,3497	0,3774	0,4052	0,4329	45 dB
	Sn [%]	86,69	88,07	88,99	89,63	90,11	90,49	90,79	91,03	91,23	91,40	91,55	91,68	91,79	
	Q [m³/h]	3.140,00	3.830,00	4.510,00	5.190,00	5.860,00	6.540,00	7.210,00	7.880,00	8.550,00	9.220,00	9.880,00	10.550,00	11.220,00	
	Δp [Pa]	8,02	6,10	4,97	4,24	3,73	3,37	3,09	2,87	2,70	2,56	2,43	2,34	2,25	
	Q [m³/h]	2.560,00	3.110,00	3.670,00	4.220,00	4.770,00	5.310,00	5.860,00	6.400,00	6.950,00	7.490,00	8.040,00	8.580,00	9.120,00	40 dB
	Δp [Pa]	5,33	4,02	3,29	2,80	2,47	2,22	2,04	1,90	1,78	1,69	1,61	1,54	1,49	
	Q [m³/h]	2.080,00	2.530,00	2.980,00	3.430,00	3.880,00	4.320,00	4.760,00	5.210,00	5.650,00	6.090,00	6.530,00	6.970,00	7.410,00	35 dB
	Δp [Pa]	3,52	2,66	2,17	1,85	1,64	1,47	1,35	1,26	1,18	1,12	1,06	1,02	0,98	
	Q [m³/h]	1.690,00	2.060,00	2.420,00	2.790,00	3.150,00	3.510,00	3.870,00	4.230,00	4.590,00	4.950,00	5.310,00	5.670,00	6.030,00	30 dB
	Δp [Pa]	2,32	1,76	1,43	1,23	1,08	0,97	0,89	0,83	0,78	0,74	0,70	0,67	0,65	
	Q [m³/h]	1.380,00	1.670,00	1.970,00	2.270,00	2.560,00	2.860,00	3.150,00	3.440,00	3.730,00	4.030,00	4.320,00	4.610,00	4.900,00	25 dB
	Δp [Pa]	1,55	1,16	0,95	0,81	0,71	0,65	0,59	0,55	0,51	0,49	0,47	0,45	0,43	

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension.


Correction factor ΔL

Correction factor ΔL

To obtain the sound power level for the octave midband: $LW_{oct} = \Delta L + L_{wa}$

[Hz]	63	125	250	500	1000	2000	4000	8000
2 - 4 m/s	22	9	-2	-11	-18	-21	-17	-8
6 - 8 m/s	17	10	1	-4	-8	-13	-19	-21
10 - 12 m/s	15	9	0	-4	-7	-10	-14	-20

Sample order

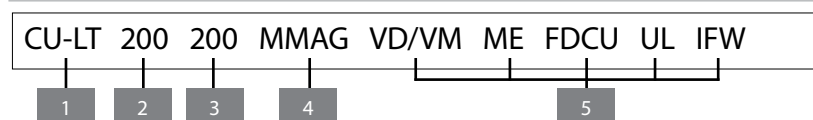

1. product
2. width
3. height
4. mechanism type
5. option: type magnet and voltage
option: resetting motor
option: uni/bipolar switches
option: inspection shutter
option: positioning kit flexible wall IFW

Approvals and certificates

All our dampers are submitted to a number of tests by official test institutes. Reports of these tests form the basis for the approvals of our dampers.



BC1-606-0464-15650.05-0464; BC1-606-0464-15650.15-2517



05.19



SC0644-15



23202



Z-56.4212-1009



9001: 2008

The NF-label guarantees: conformity with the standard NF S 61-937 Parts 1 and 5: "Systèmes de Sécurité Incendie Dispositifs Actionnés de Sécurité"; conformity with the national decree of March 22, 2004, changed on 14 March 2011 for the classification of fire resistance; the values of the characteristics mentioned in this document. Organisme Certificateur: AFNOR Certification, 11 Rue Francis de Pressensé, F93571 La Plaine Saint-Denis Cedex; Website: <http://www.afnor.org> <http://www.marquage-nf.com>; Phone: +33 (0)1.41.62.80.00, Fax: +33 (0)1.49.17.90.00, Email: certification@afnor.org